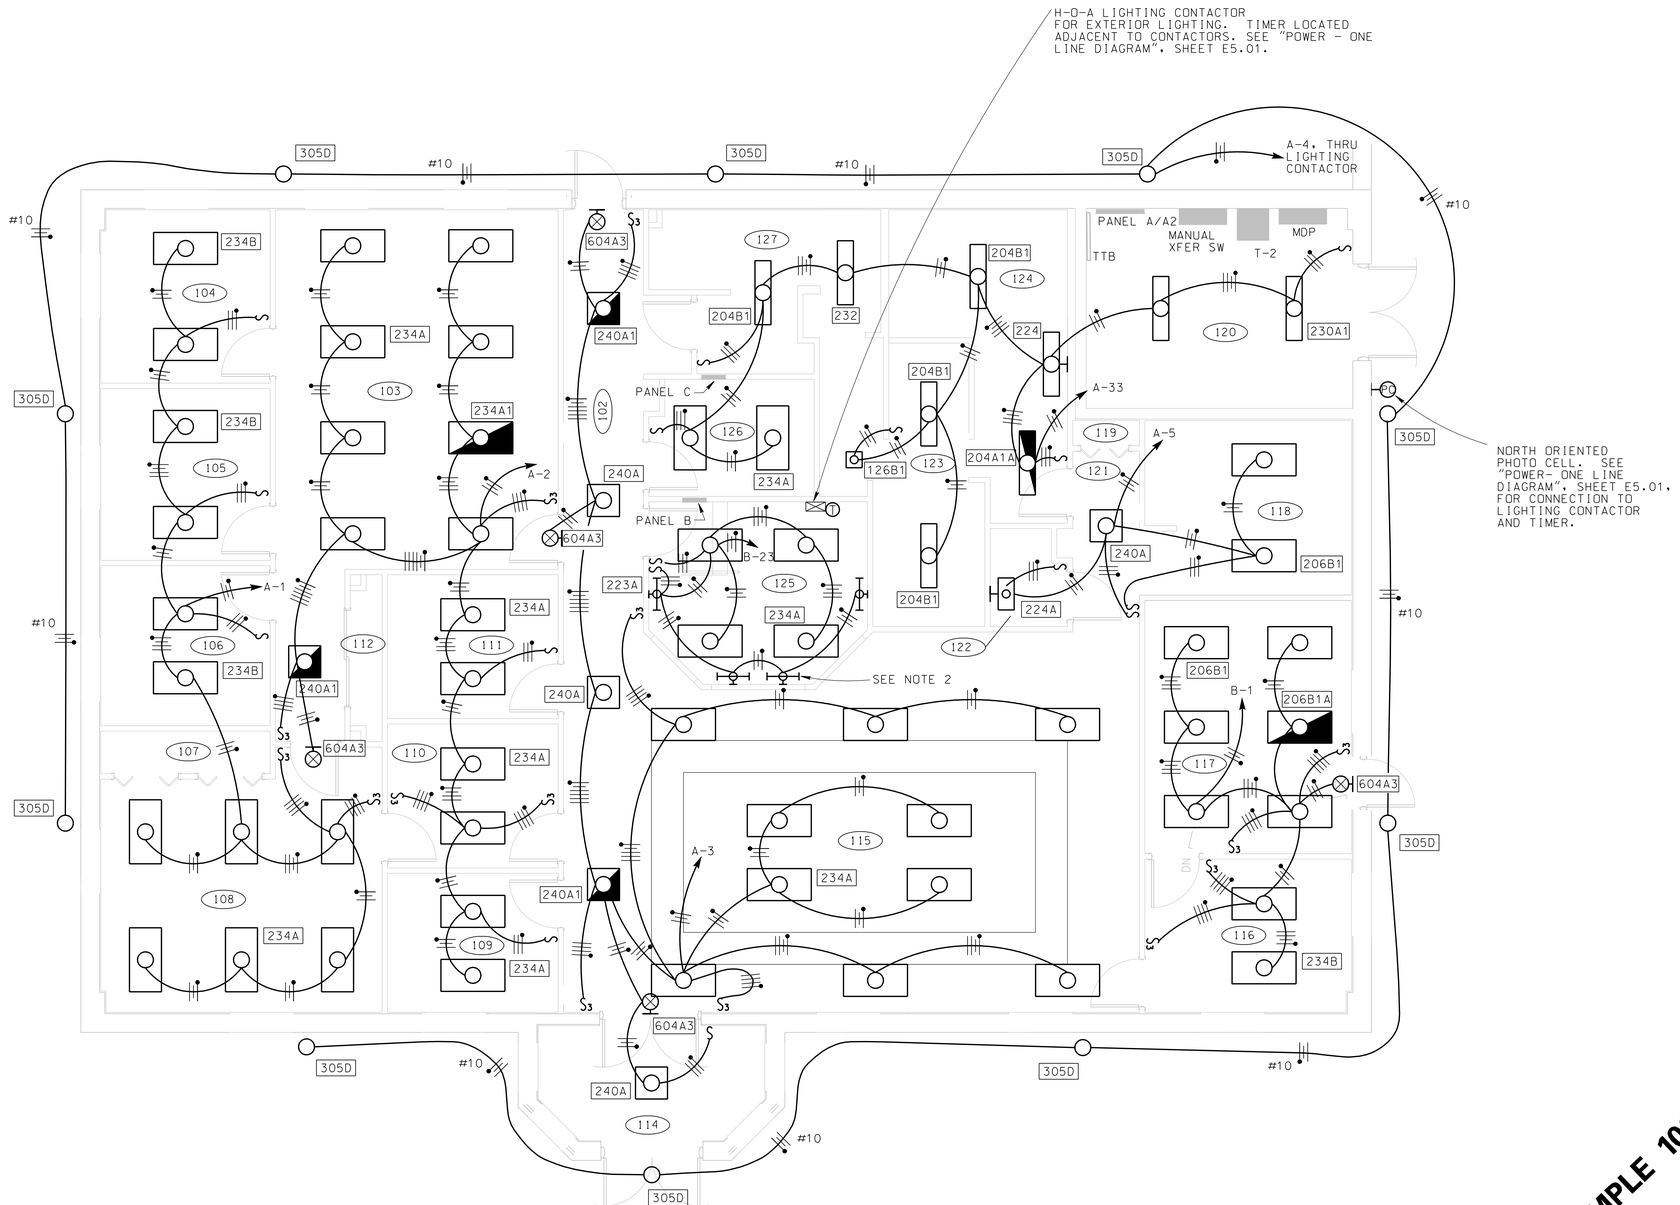

NOTES:

1. ROOM 117 IS CLASS I, DIVISION II, GROUP D TO +48" ABOVE FLOOR. MOUNT SWITCHES @ 50" TO BOTTOM OF PLATE.
2. TYPE 223A, INSTALL UNDER COUNTER. SEE ARCH. PLANS FOR EXACT LOCATION.

ROOM LEGEND	
101	NOT USED
102	CORRIDOR
103	ADMINISTRATION AREA
104	OIC OFFICE
105	FS OFFICE
106	TRAIN. OFFICE
107	STORAGE
108	CONF./CLASSROOM
109	OS OFFICE
110	NCOIC OFFICE
111	SHIFT OFFICE
112	STORAGE
113	NOT USED
114	VESTIBULE
115	READY ROOM
116	QC INSPECTOR
117	LABORATORY
118	BREAK AREA
119	STORAGE
120	MECHANICAL ROOM
121	CORRIDOR
122	JANITOR
123	MEN'S LOCKER ROOM
124	MEN'S TOILET
125	FCC OFFICE
126	COMPUTER ROOM
127	WOMEN'S TOILET

EXAMPLE 100% DESIGN

LIGHTING PLAN

SCALE: 1/4 INCH = 1 FOOT

12" 0 5'

N

$$ – THINK VALUE ENGINEERING – $$

Revisions

Symbol	Descriptions	Date	Approved

U.S. ARMY ENGINEER DISTRICT
CORPS OF ENGINEERS
OMAHA, NEBRASKA

Designed by: XXX
Drawn by: XXX
Checked by: XXX
Reviewed by: XXX
Submitted by:
Chief: ELECTRICAL Section

SITE NAME: OMAHA DISTRICT DESIGN GUIDE
SITE LOCATION

LIGHTING PLAN

Plot Scale Ratio: 4:1
Design File: oddga001.dgn
Date: JUNE 2002
Spec. No.: DACA 45
Contract No.: DACA 45
Drawing Code: X
Sheet reference number: **E1.01**

COMPUTER AIDED DESIGN & DRAFTING

d:\oddg\elec\ex__e101.dgn 05/29/02 11:27:40 AM